

The following items must be performed or provided at no cost to Otis Elevator Company ("Ots") by the Owner or General Contractor or their agents in accordance with governing codes. The price and installation schedule of Ots is based on these job-site conditions existing at the beginning and during the installation of the elevator equipment. Failure to provide the items specified in this list will result in additional work performed by Ots Elevator beyond the scope of our contract causing installation delays. A change order will be submitted by Ots for materials and/or labor expended. All work must be performed per the applicable national and/or local codes.

General Prep/Work

1. Provide on-site storage area for elevator equipment as follows: dry and enclosed, provides reliable access to the elevator hoistway at the ground level, located within 100 feet (30480mm) of the hoistway and is larger than 25 x 20 feet (7620mm x 6096mm) per elevator. Any warranties provided by Ots for elevator equipment are null and void if equipment is stored in a manner other than a dry enclosed building structure.
2. Provide sufficient on-site refuse containers for the proper disposal of elevator packaging material. Sufficient refuse containers not be provided, disposal of packaging material shall become the responsibility of the owner.
3. Provide any cutouts to accommodate elevator equipment (troughing, venting, and hall fixtures), along with the patching/painting of walls, floors, or partitions together with finish painting of entrance doors and frames, if required.

Hoistway & Pit Prep/Work

4. Provide and install a steel I-beam shaped safety beam with a maximum flange width of 8 11/16" (220mm), from side wall to side wall at the top of the hoistway, capable of withstanding a minimum net live load of 7500 lb (3402 kg) per elevator. Reference Ots Layout for location, A 4" minimum clearance is required from top of beam to top of hoistway.
5. Provide a clear plumb hoistway with variations from the size shown on the Ots layout not to exceed +/-1" (25mm) and not less than the clear dimensions shown on the Ots layout
6. Provide adequate rail bracket supports, bracket spacing as required by governing code, from pit floor to top of hoistway comply with the rail reaction forces detailed on the Ots Contract Layout. Provide adequate support for the top rail circuit breaker located on the Ots Layout. Provide separate support beams where required. Unless approved by Ots, rail-bracket attachment supports must be exposed and flush with the clear hoistway line. If the floor-to-floor height exceeds the maximum bracket spacing allowed by the elevator code, Ots requires some form of steel support to properly attach our guide rail brackets. The maximum allowed bracket spacing is indicated in the rail force and bracket detail table on the Ots layout. Any rail bracket mounting surfaces that are not in line with the finished hoistway dimension (i.e. the clear hoistway line) may need to be extended to meet the required distance. Ots agrees to provide guidance on this matter at the appropriate time.

If rail bracket embedded plates or inserts are provided by Ots they shall be installed by others in accordance with Ots documentation and instructions.

7. Vertical tube steel is utilized as a rail support on car rail side, opposite cwt, (2) vertical tubes spaced at 20.4" (519mm) on center are required for car rail brackets with "X" dimension >= 5.78" (146mm).
7. Provide adequate support at all fastener points of each entrance. Provide plumb vertical surfaces for entrances and sill supports, one above the other, and square with the hoistway. Finish floor and grout, if required, between entrances and building sill line. For MRL installations, a horizontal support member is to be provided 20" (508mm) above the clear opening at the controller landing to support the entrance and controller components. If any other floor height exceeds 12'-0" (3657mm), a horizontal support member is to be provided 12" (305mm) above the clear opening.

Prior to the start of installation, provide a dry, properly framed, enclosed and vented hoistway in accordance with all applicable codes.

- 9.A.) Protection from Falls: As required by the Occupational Safety and Health Administration (OSHA) 1926.502.6 (1)-3) a freestanding removable barricade at each hoistway opening at each floor. Barricades shall be 42" (1067mm) high, with mid-rail and kick board, and withstand 200 lbs. (90.7kg) of vertical and horizontal pressure. B.) Protection from Falling Objects: As required by the Occupational Safety and Health Administration (OSHA) 1926.502(j) hoistway protection from falling debris and other trades materials by either:
 - 1.) Full entrance screening/mesh in front of all elevator entrances
 - 2.) Secured/controlled access to all elevator lobbies (lock and key) with posted Notice "Only elevator personnel beyond this protection."

Notes:
Items A.) and B.) can be integrated systems.
Hoistway barricades and screening shall be constructed, maintained and removed by others.

10. Provide a pit floor designed to sustain vertical forces (based on safety impact) on car and counterweight rails and impact loads on car and counterweight buffers as shown on the Ots layout. The pit must be dry and clean. The elevator pit must have a floor drain or sump pump to prevent the accumulation of water. Location to be coordinated with Ots to avoid all elevator components and access areas. In areas requiring fire fighters emergency operation (FEO) a sump pump/drain shall be provided that shall have the capacity to remove a minimum of 11.4 m3h (3,000 gal/h) per elevator (2.2,2.5, ASME A17.1-2007/CSA B44-07). Ots recommends that the owner verify the drain or sump pump system is in compliance with all applicable codes and laws.
11. The front entrance wall at the main landing and top landing, is not to be constructed until after all elevator installation is installed on the hoistway (the end of the hoistway - EWO) and WADTH must be open for installation). Remaining front entrance walls are not to be constructed until after door frames and sills are in place. The rough openings, per sizes shown on the Ots layout, are required. Prior to the completion and turnover of the elevator(s), all entrance walls must be installed and rough openings filled in complete to maintain fire rated hoistway requirements.

12. Provide and install a fixed vertical iron ladder in each pit as required by governing code and located per Ots layout or as coordinated with Ots personnel. Ladder width and pit wall pocket requirements are shown in the pit plan view on the Ots layout.
13. Install permanent light fixture at each elevator pit with illumination of not less than 100 lx (10 fc) as measured at the pit floor. The light bulb(s) shall be externally guarded to prevent contact and accidental breakage. The light switch shall be so located as to be accessible from the pit ladder.
14. Glass used in hoistway construction must block 98% or more of incident full-spectrum ultraviolet radiation for the full height of the hoistway.
15. Provide and install guarding of counterweight in a multiple-elevator hoistway as required, when a counterweight is located between elevators, the counterweight runway shall be guarded on the side next to the adjacent elevator. The guarding must meet or exceed the requirements of ASME A17.1-2007, section 2.11.1.2, section 3.1.3, 3.2.

If an emergency door in a blind hoistway is required, provide an outward swinging single section type door with door closer and a self closing barrier per ASME A17.1-2007, section 2.11.1.2. Contact your local Ots personnel for a detailed drawing (AAA26900D_FMI) showing Ots specific requirements.

MRL Machine Space Prep/Work

15. Maintain the temperature at the top of the hoistway (machine space) between 32° F (0° C) and 104° F (40° C). This space also includes the car controller which is mounted at the top landing. Relative humidity shall not to exceed 95% non-condensing. Provide ventilation to suit Ots heat release amounts as shown in Ots Confirmation of Power Supply Form. Local codes may require higher temperature ranges and higher ventilation levels. Please check with your local code authority for the exact requirements in your area. If your machinery space temperature exceeds this requirement, contact your local Ots sales representative for assistance.
17. Install a permanent light fixture at the top of the hoistway (machine space) of not less than 200-lux (18 fc) as measured at the level of the standing surface on the car when the elevator is at the top landing. Light switch is to be located in the hoistway per the Ots layout.
18. Install a permanent light fixture at the top landing entrance (control space), in the hall, of not less than 200-lux (19 fc) as measured at the floor level. Light switch is to be located close to the elevator entrance.

Control Room/Space and Machine Space Prep/Work

19. Provide a suitable control room/space(s) with access and ventilation in accordance with all applicable codes and regulations. The control room/space(s) shall be maintained at a temperature between 32° F (0° C) and 104° F (40° C) to be measured 6 feet (1830 mm) above the floor and 1 foot (305 mm) out from the front center of the car controller(s). Relative humidity is not to exceed 95% non-condensing. Provide ventilation to suit Ots heat release amounts as shown on the Ots Confirmation of Power Supply Form. Local codes may require lighter temperature ranges and higher ventilation levels, please check with your local code authority for the exact requirements in your area. If your control room/space(s) temperatures exceeded these requirements, contact your local Ots sales representative for assistance.

20. Provide illumination of control room/space(s) of not less than 200 LUX (19 FC) as measured at floor level. Light switch is to be located within 18" (457 mm) to the lock-jamb side of the access door to the control room/space(s), ensure that all gaps around the doors are sealed (i.e. threshold, weather stripping, etc.).
21. Provide control room/space(s) with self-closing and self-locking doors with a group 2 locking device. In addition, ensure that all gaps around the doors are sealed (i.e. threshold, weather stripping, etc.).
22. Maintain the temperature at the top of the hoistway (machine space) between 32° F (0° C) and 104° F (40° C). Relative humidity shall not to exceed 95% non-condensing. Provide ventilation to suit Ots heat release amounts as shown in Ots Confirmation of Power Supply Form. If your machinery space temperature exceeds this requirement, contact your local Ots sales representative for assistance.
23. Install a permanent light fixture at the top of the hoistway (machine space) of not less than 200-lux (18 fc) as measured at the level of the standing surface on the car when the elevator is at the top landing. Light switch is to be located in the hoistway per the Ots layout.

Fire Prevention Prep/Work

24. Provide hoistway walls designed and constructed in accordance with the required fire rating (including those places where elevator fixture boxes, rail bracket fastenings, and any other penetration into the hoistway walls).
25. In the United States provide smoke detectors, located as required, with wiring from the sensing devices to the controller(s) designated by Ots.
 - A. For each group of elevators, provide a normally closed contact representing the smoke detector at the designated return landing.
 - B. For each group of elevators, provide a normally closed contact representing all smoke detectors located in lobbies, hoistways, or control rooms/spaces but not the smoke detector at the designated return landing (see above) or the smoke detectors as described below.
 - 1) If a smoke detector is located in the hoistway at or below the lower of the two recall landings, it shall be wired to activate the same normally closed contact as the smoke detector located in the lobby at the lower of the two recall landings.
 - 2) If the control room/space(s) are located at the designated return landing, the smoke detectors located therein shall be wired to activate the same normally closed contact as the smoke detector at the designated landing.
26. In Canada provide smoke detectors, located as required, with wiring from the sensing devices to the controller(s) designated by Ots.
 - A. For each group of elevators, provide a normally closed contact representing the smoke detector at the designated return landing and if provided, from the sensing device in the pit.
 - B. For each group of elevators, provide a normally closed contact representing all smoke detectors located in elevator lobbies, but not the smoke detector at the designated return landing (see above), and if provided, from the sensing device in the top of the hoistway.
 - C. For each group of elevators, provide a normally closed contact representing the smoke detector in the elevator machine space.
 - D. If the control space is located at the designated return landing, the smoke detectors located therein shall be wired to activate the same normally closed contact as the smoke detector at the designated landing. For each group of elevators, provide in addition to the above, a normally closed contact representing the sensing devices in the pit at or below the top of the hoistway (for the Fire Hit the Elevator).
27. In the United States, if sprinklers are installed in the hoistway(s), or machine space(s), a means to automatically disconnect the main line power supply of the affected elevator and any other power supply used to move the elevator upon or prior to the application of water is required (unless prohibited by local code). Smoke detectors shall not be used to activate sprinklers in hoistway(s), or machinery spaces or to disconnect the mainline power supply. In addition, when the Automatic Recovery Operation (ARO) is specified, the means provided to automatically disconnect power to the elevator shall be equipped with an additional contact that is positively opened when power is removed from the elevator system. This automatically controlled mainline disconnect must be provided with all associated wiring and conduit to the controller.
28. Provide an "ABC" fire extinguisher, minimum 10 lbs for machine space, and located convenient to the top landing elevator entrance.
29. Provide control room/space(s) and door to code compliant fire-resistive construction.

Electrical Requirements

30. 3 Phase Power MRL - Provide a permanent three (3) phase electrical-feeder system with a separate equipment-grounding conductor terminating in the elevator controller located at the top landing or transformer located at the point of power distribution in the building. The electrical-feeder to be terminated at the elevator controller or transformer at the start of installation of the top landing elevator entrance and the timing of connection to Ots controller shall be coordinated with the elevator installer. Feeder conductors and grounding conductor sized according to elevator current characteristics as shown on the Ots Confirmation of Power Supply Form. Feeder conductors and grounding conductor must be copper. Provide a fused disconnect switch or circuit breaker capable of being locked in the open position, for each elevator per the National Electrical Code (ANSI/NFPA 70) or Canadian Electrical Code (CEC [22.1] with feeder or branch wiring to elevator controller [NEC 620-51, 620-61(D), and 620-62] or [CEC Rule 38-013 (2) (a)] located at the point of power distribution in the building. The disconnecting means required by the National Electrical Code or Canadian Electrical Code CEC [Rule 38-051] shall be provided with all associated wiring and conduit to the elevator controller. Size of main contacts to suit elevator power characteristics. Fuses, if provided, are to be current limiting class RK1 or equivalent. Circuit breakers, if provided, are to have current limiting characteristics equivalent to class J fuses. Fuses or circuit breakers are to be time delay to cover the full load up accelerating current. Accelerating current typically is the peak as indicated on the Ots Confirmation of Power Supply Form, and lasts for duration not to exceed 7 seconds. Feeder conductors and associated wiring to the controller to be sized to limit wiring voltage drop to 5% maximum when delivering elevator full load up accelerating current. The building power system used to operate the elevator(s) shall be capable of supplying non linear loads and be capable of absorbing the regenerated power listed on the Ots Confirmation of Power Supply Form. Single Phase Power MRL - Provide a permanent single phase electrical-feeder system with a separate equipment-grounding conductor terminating in the transformer located in the electrical room. Permanent single phase electrical-feeder to be terminated at the transformer at the start of installation of the top landing elevator entrance and the timing of connection to Ots controller shall be coordinated with the elevator installer. Feeder conductors and grounding conductor sized according to elevator current characteristics as shown on the Ots Confirmation of Power Supply Form. Feeder conductors and grounding conductor must be copper. Provide a fused disconnect switch or circuit breaker capable of being locked in the open position, for each elevator per the National Electrical Code (ANSI/NFPA 70) or Canadian Electrical Code (CEC [22.1] with feeder or branch wiring to elevator controller [NEC 620-51, 620-61(D), and 620-62] or [CEC Rule 38-013 (2) (a)] located at the point of power distribution in the building. The disconnecting means required by the National Electrical Code or Canadian Electrical Code CEC [Rule 38-051] shall be provided with all associated wiring and conduit to the elevator controller. Size of main contacts to suit elevator power characteristics. Fuses, if provided, are to be current limiting class RK1 or equivalent. Circuit breakers, if provided, are to have current limiting characteristics equivalent to class J fuses. Fuses or circuit breakers are to be time delay to cover the full load up accelerating current. Accelerating current typically is the peak as indicated on the Ots Confirmation of Power Supply Form, and lasts for duration not to exceed 7 seconds. Feeder conductors and associated wiring to the controller to be sized to limit wiring voltage drop to 5% maximum when delivering elevator full load up accelerating current. The building power system used to operate the elevator(s) shall be capable of supplying non linear loads and be capable of absorbing the regenerated power listed on the Ots Confirmation of Power Supply Form.

MRL Configuration (controller located in hoistway entrance) with Transformer - If a transformer is required and the controller is to be located in the hoistway entrance, the transformer must be located in an electrical room. The transformer must be mounted and wired as per the National Electrical Code (ANSI/NFPA 70) or Canadian Electrical Code (CEC [22.1]). Provide conduit and wiring to the transformer as well as between the transformer and the controller located in the hoistway entrance in accordance with the National Electrical Code (ANSI/NFPA 70) or Canadian Electrical Code (CEC [22.1]). Contact your local Ots sales representative for details.

31. 3 Phase Power Control Room/Space - Provide a permanent three (3) phase electrical-feeder system with a separate equipment-grounding conductor terminating in the control room/space(s), located per Ots layout. Feeder conductors and grounding conductor sized according to elevator current characteristics as shown on the Ots Confirmation of Power Supply Form. Feeder conductors and grounding conductor must be copper. A fused disconnect switch or circuit breaker capable of being locked in the open position, for each elevator per the National Electrical Code (ANSI/NFPA 70) or Canadian Electrical Code (CEC [22.1] with feeder or branch wiring to controller [NEC 620-51, 620-61(D), and 620-62] or [CEC Rule 38-013(2)(a)]). The disconnecting means required by the National Electrical Code or Canadian Electrical Code CEC [Rule 38-051] shall be provided with all associated wiring and conduit to the controller. Size of main contacts to suit elevator power characteristics. Fuses are to be current limiting class RK1 or equivalent. Circuit breakers are to have current limiting characteristics equivalent to class RK1 fuses. Fuses or circuit breakers are to be time delay to cover the full load up accelerating current. Accelerating current typically is the peak as indicated on the Ots Confirmation of Power Supply Form, and lasts for duration not to exceed 7 seconds. Feeder conductors and associated wiring to the controller to be sized to limit wiring voltage drop to 5% maximum when delivering elevator full load up accelerating current. The building power system used to operate the elevator(s) shall be capable of supplying non linear loads and be capable of absorbing the regenerated power listed on the Ots Confirmation of Power Supply Form.

- Single Phase Power Control Room/Space - Provide a permanent single phase electrical-feeder system with a separate equipment-grounding conductor terminating in the control room/space(s), located per Ots layout. Feeder conductors and grounding conductor sized according to elevator current characteristics as shown on the Ots Confirmation of Power Supply Form. Feeder conductors and grounding conductor must be copper. A fused disconnect switch or circuit breaker capable of being locked in the open position, for each elevator per the National Electrical Code (ANSI/NFPA 70) or Canadian Electrical Code (CEC [22.1] with feeder or branch wiring to controller [NEC 620-51, 620-61(D), and 620-62] or [CEC Rule 38-013(2)(a)]). The disconnecting means required by the National Electrical Code or Canadian Electrical Code CEC [Rule 38-051] shall be provided with all associated wiring and conduit to the controller. Size of main contacts to suit elevator power characteristics. Fuses are to be current limiting class RK1 or equivalent. Circuit breakers are to have current limiting characteristics equivalent to class RK1 fuses. Fuses or circuit breakers are to be time delay to cover the full load up accelerating current. Accelerating current typically is the peak as indicated on the Ots Confirmation of Power Supply Form, and lasts for duration not to exceed 7 seconds. Feeder conductors and associated wiring to the controller to be sized to limit wiring voltage drop to 5% maximum when delivering elevator full load up accelerating current. The building power system used to operate the elevator(s) shall be capable of supplying non linear loads and be capable of absorbing the regenerated power listed on the Ots Confirmation of Power Supply Form.

32. Provide a dedicated 125 volt, 15 ampere single-phase branch circuit with a fused disconnect switch or circuit breaker located at the point of power distribution in the building. The fused disconnect or circuit breaker shall be capable of being locked in the open position. This branch circuit supplies the car lights, car top receptacle, auxiliary lighting power source and ventilation on each car in compliance with the National Electrical Code [NEC620-53] or Canadian Electrical Code [CEC Rule 38-053]. Termination of this branch circuit shall be in the elevator controller located at the top landing and shall be connected at the same time as the permanent three (3) phase power referenced in the previous paragraph.

33. All 125 volt, 15 or 20 ampere single-phase receptacles installed in pits, machine spaces, control rooms/space(s) shall be of the ground-fault circuit-interrupter type (GFCI). A dedicated single-phase receptacle supplying a permanently installed pit sump pump shall not require GFCI protection.
34. Provide electric power for lights, tools, welding, hoisting, etc. during installation with sufficient power for starting, testing and adjusting the elevator. Provide a 230 volt, 30 ampere single-phase 4 wire electrical supply for platform operation during construction, available at the start of elevator installation.

35. Provide one (1) dedicated outside telephone line, per elevator, and terminated at the controller designated by the Ots construction superintendent. Reference the A17.1 code and the Ots power of confirmation letter for specific requirements.
36. In areas under the jurisdiction of ASME A17.1-2004/CSA B44 or later where the elevator travel is greater than or equal to 50 feet/15 meters, provide two-way voice communications means that shall enable emergency personnel within the building to establish communications to each car individually without intervention by a person within the car. The communication means shall override communications to the outside of the building and once established shall only be terminated by emergency personnel outside the car. Refer to ASME A17.1-2004 CSA B44 or later, section 2.27.1.1.4 for exact requirements.

37. [Optional] For elevators having an intra building interior, provide a separate 120 volt, 15 ampere, single phase power supply with fused SPD disconnect switch or circuit breaker, located as required for inter-communicating system power supply. Circuit to be arranged for feeding from the building emergency lighting supply if provided. Conduit and wiring for remotely located inter-communicating stations.

38. [Optional] For installations having emergency (standby) power, provide the standby power unit and means for starting it. The emergency (standby) power unit shall deliver to the elevator via disconnect switches in the building power distribution location or disconnect switches in the control room/space(s), sufficient power to operate one or more elevators at a time at full rated speed, and rated load. An automatic power transfer switch for each power feeder to monitor both normal and emergency (standby) power conditions and to perform the transfer from one to the other. Switch to have two sets of normally closed dry contacts, one to be open when the switch is in the emergency (standby) power position, the other to open upon initiation of power transfer and to close when transfer is complete. Switch to have an inhibition circuit which will delay transfer to normal and/or emergency (standby) power by an adjustable period of 0 - 300 seconds. Switch shall have a phase monitor feature, which prohibits the transfer of power between "V" sources unless the sources are in phase with each other. If a shunt trip device is provided, an additional normally closed contact, with all associated wiring and conduit, shall be provided to the emergency (standby) power source. The emergency (standby) power system provided shall comply with ANSI/NFPA 70 requirements 620.91. The table in section "ELEVATOR REGENERATIVE POWER REQUIREMENTS", on the Ots Confirmation of Power Supply Form, contains the elevator system power (regenerated) under an overhauling load. The information contained in the form is to be used to determine regenerative power absorption capability for the emergency (standby) power distribution system. Note: The Building Emergency (Standby Power) Generator system used to operate the elevator(s) shall be capable of supplying non-linear loads.

You agree to indemnify and save Ots harmless against any and all liability and costs arising out of your failure to carry out any of the foregoing requirements.

FOR REFERENCE ONLY

Gen2®
3500# @ 150 F.P.M.
SEISMIC 0/1




Otis
A United Technologies Company

DWG. NO.: G2S 3500-PWBO SHEET 1 OF 3

BUILDING	Isabella Citizens for Health
LOCATION	Mount Pleasant Michigan
CONT. WITH	Bruce Dietz
OWNER	TBD
ARCHT.	TBD
SHEET NO.	TBD

THIS WORK AND THE INFORMATION IT CONTAINS ARE THE PROPERTY OF OTIS ELEVATOR COMPANY. IT IS TO BE USED ONLY FOR OR ON BEHALF OF OTIS. IT IS NOT TO BE REPRODUCED OR DISCLOSED IN ANY MANNER IN PART, WITHOUT THE PRIOR WRITTEN CONSENT OF OTIS AND THAT OTIS DISCLAIMS ANY COPIES WILL BE PROMPTLY RETURNED TO OTIS.

UNPUBLISHED WORK © OTIS ELEVATOR COMPANY 2004 ALL RIGHTS RESERVED

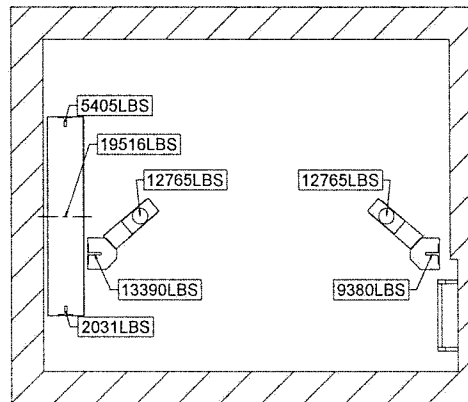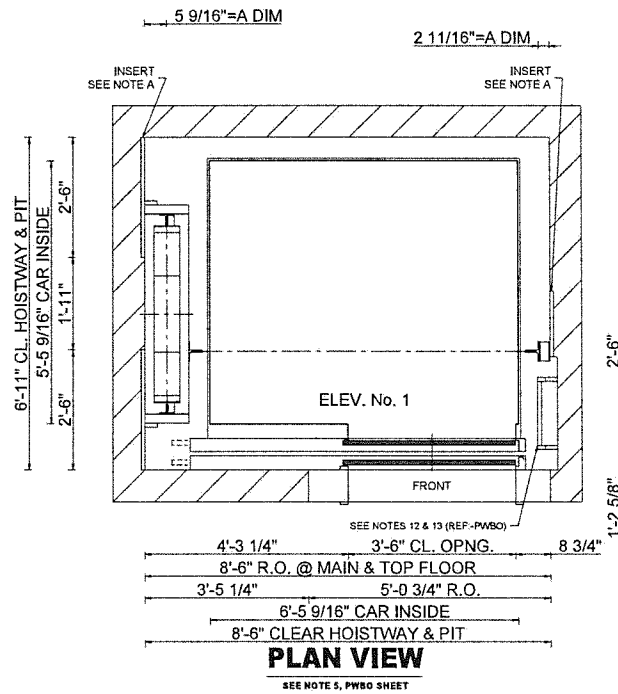

PIT PLAN VIEW

FORCE SHOWN INCLUDES DOUBLING FOR IMPACT

FOR REFERENCE ONLY

NOTE A
 THESE DIMENSIONS ARE BASED ON HOISTWAY SIZES SHOWN & 30" INSERTS. IF EITHER OF THESE VARY, CONSULT THE SALES REPRESENTATIVE.

APPROVAL
 THIS ARRANGEMENT AND SUPPLEMENTARY NOTES APPROVED

SIGNED: _____ DATE: _____

THIS WORK AND THE INFORMATION IT CONTAINS ARE THE PROPERTY OF OTIS ELEVATOR COMPANY ("OTIS"). IT IS DELIVERED TO OTHERS ON THE EXPRESS CONDITION THAT IT WILL BE USED ONLY FOR OR ON BEHALF OF OTIS. THAT NEITHER IT NOR THE INFORMATION IT CONTAINS WILL BE REPRODUCED OR DISCLOSED, IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF OTIS, AND THAT ON DEMAND IT AND ANY COPIES WILL BE PROMPTLY RETURNED TO OTIS.

UNPUBLISHED WORK © OTIS ELEVATOR COMPANY 2004
 ALL RIGHTS RESERVED.

Gen2®
 3500# @ 150 F.P.M.
 SEISMIC 0/1

Otis
 A United Technologies Company

DWG. NO.: G2S 3500-PN

BUILDING Isabella Citizens for Health


LOCATION Mount Pleasant Michigan

CONT. WITH Bruce Dietz

OWNER TBD

ARCHT. TBD


CONTRACT NO. TBD



HALL FIXTURE DETAIL

FINISHED FLOOR

① HALL BUTTONS @ ALL FLOORS

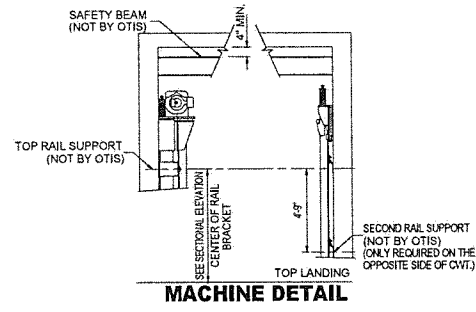

RAIL FORCE & BRACKET SPACING DETAIL

SEE NOTES 6 & 7

GROUP	TYPE	VALUE
CAR	R1	518 lbs
	R2	90 lbs
	VX	N/A
	VY	N/A
	MAXIMUM BRACKET SPACING	12' 0"
CWT	RAIL SIZE	1-1/2
	R1	265 lbs
	R2	19 lbs
	VX	N/A
	VY	N/A
MAXIMUM BRACKET SPACING		12' 0"
	RAIL SIZE	2
DEH (DEAD END HITCH)	R1	860 lbs
	R2	1590 lbs


IN MULTICAR GROUPS THE VALUES ABOVE ARE THE LARGEST VALUES FOR THE ENTIRE GROUP

FIRST INTERMEDIATE RAIL SUPPORT LOCATION TO BE LOCATED 14' 0" FROM PIT FLOOR. ALL OTHER INTERMEDIATE SUPPORTS CANNOT EXCEED THE MAXIMUM BRACKET SPACING IN THE RAIL FORCE & BRACKET SPACING DETAIL.

CAR R1 = SAFETY APPLICATION
 CWT R1 = LOADING OR RUNNING
 R2 = LOADING OR RUNNING

REQUIREMENTS FOR RAIL BRACKET SUPPORT (NOT BY OTIS):
 DEFLECTION NOT TO EXCEED 1/8" BASED ON HORIZONTAL RAIL FORCES.


NOTE J
 ROUGH OPENING AT ALL FLOORS, EXCEPT TOP LANDING, EQUALS 7'-10"
 TOP LANDING EQUALS 8'-8".

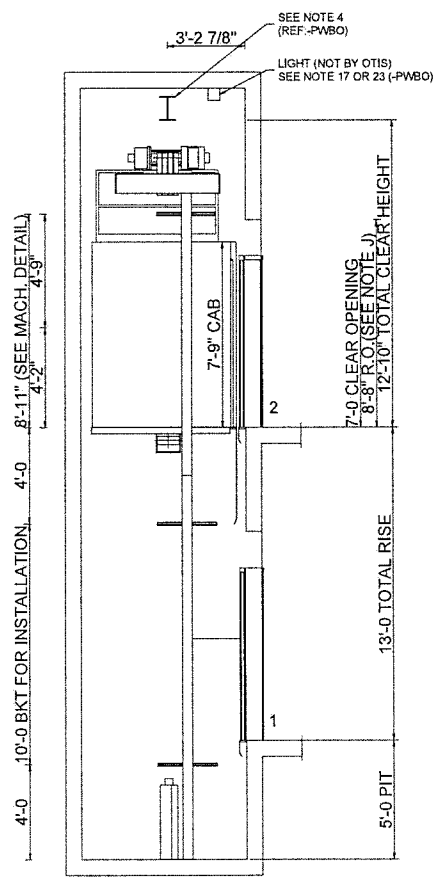

SECTIONAL ELEVATION

FOR MAX. SPACING BETWEEN INSERTS SEE RAIL FORCE DETAIL

FOR REFERENCE ONLY

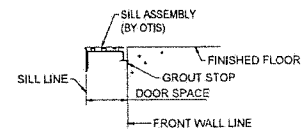

DETAIL "A" SILL SUPPORT

ADEQUATE SUPPORT AT ALL FASTENING POINTS OF ENTRANCE ASSEMBLY REQUIRED. MUST WITHSTAND A HORIZONTAL PULL-OUT FORCE OF 140 LBS. @ EA. FASTENING POINT (6 @ EA. ENTRANCE) INCLUDING SUPPORT FOR CENTER SILL SUPPORT BRACKET (NOT BY OTIS).

APPROVAL
 THIS ARRANGEMENT AND
 SUPPLEMENTARY NOTES APPROVED

SIGNED: _____ DATE: _____

THIS WORK AND THE INFORMATION IT CONTAINS ARE THE PROPERTY OF OTIS ELEVATOR COMPANY ("OTIS"). IT IS DELIVERED TO OTHERS ON THE EXPRESS CONDITION THAT IT WILL BE USED ONLY FOR OR ON BEHALF OF OTIS THAT NEITHER IT NOR THE INFORMATION IT CONTAINS WILL BE REPRODUCED OR DISCLOSED IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF OTIS, AND THAT ON DEMAND IT AND ANY COPIES WILL BE PROMPTLY RETURNED TO OTIS.

UNPUBLISHED WORK © OTIS ELEVATOR COMPANY 2004
 ALL RIGHTS RESERVED.

Gen2®

**3500# @ 150 F.P.M.
 SEISMIC 0/1**

Otis
 A United Technologies Company

DWG. NO.: **G2S 3500-EL**

BUILDING **Isabella Citizens for Health**

LOCATION **Mount Pleasant Michigan**


CONT. WITH **Bruce Dietz**

OWNER **TBD**

ARCHT. **TBD**

CONTRACT NO. **TBD**

ELEV NO. 1

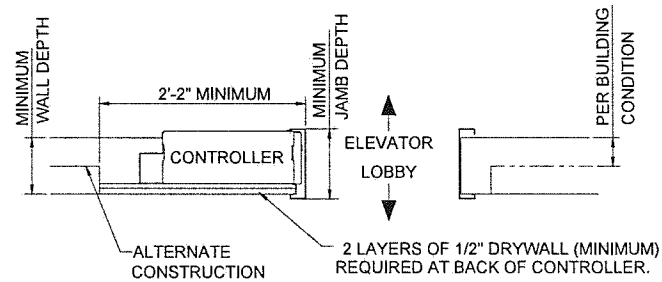

FRONT TOP LANDING ENTRANCE REQUIREMENTS
(MUST BE LOCATED AT THE TOP ENTRANCE)

TOP LANDING ENTRANCE REQUIREMENTS
(MUST BE LOCATED AT THE TOP ENTRANCE)

MRL CONTROLLER MINIMUM DEPTH REQUIREMENTS		
OTIS WALL TYPE	MINIMUM WALL DEPTH	MINIMUM JAMB DEPTH
M1 (RECESSED FRAME IN MASONRY WALL)	-	8 5/8"
NOT M1	7"	-

FOR REFERENCE ONLY

APPROVAL
THIS ARRANGEMENT AND
SUPPLEMENTARY NOTES APPROVED

SIGNED: _____ DATE: _____

THIS WORK AND THE INFORMATION IT CONTAINS ARE THE PROPERTY OF OTIS ELEVATOR COMPANY (OTIS). IT IS DELIVERED TO OTHERS ON THE EXPRESS CONDITION THAT IT WILL BE USED ONLY FOR OR ON BEHALF OF OTIS, THAT NEITHER IT NOR THE INFORMATION IT CONTAINS WILL BE REPRODUCED OR DISCLOSED, IN WHOLE OR IN PART, WITHOUT THE WRITTEN CONSENT OF OTIS, AND THAT ON DEMAND IT AND ANY COPIES WILL BE PROMPTLY RETURNED TO OTIS.

UNPUBLISHED WORK © OTIS ELEVATOR COMPANY 2004 ALL RIGHTS RESERVED.

Gen2[®]

**3500# @ 150 F.P.M.
SEISMIC 0/1**

Otis
A United Technologies Company

DWG. NO.: G2S 3500-DTL

BUILDING Isabella Citizens for Health

LOCATION Mount Pleasant Michigan

CONT. WITH Bruce Dietz

OWNER TBD

ARCHT. TBD

CONTRACT NO. TBD